





**Concentrated Sources of Potential Contamination**  
[livestock or poultry yards, cemeteries, pesticide facilities, etc]

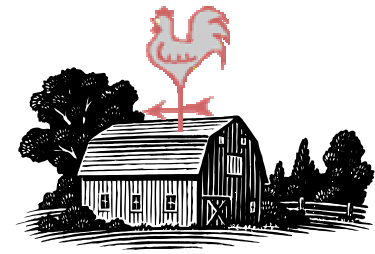

**Dry Litter Poultry Facility**

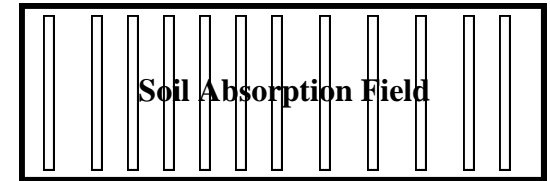

**Soil Absorption Field**

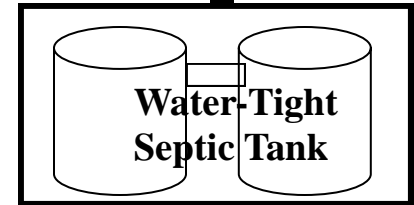

**Water-Tight Septic Tank**

**Property Line**

**Minimum Horizontal Distance 150 feet**

**Minimum Horizontal Distance of 100 feet**  
Except as noted in Rules

Public Water Supply wells may require 150 foot Sanitary Easement

**Minimum Horizontal Distance of 50 feet**

**Minimum Distance 50 feet for Exempt Well**

**Minimum Distance 150 feet for Non-Exempt Well**



**Well Location**

**Pineywoods Groundwater Conservation**